


# 1/32 DIN Digital Panel Meter K3GN

CSM\_K3GN\_DS\_E\_3\_1

## 1/32 DIN Digital Panel Meter for Downsizing Equipment and Control Panels

- Compact size: 48 x 24 x 83 (W x H x D).
- Multi-input compatible: DC voltage/current, rotary pulse.
- Two display colors (switchable): green/red.
- Selectable outputs.
- CE marking and UL/CSA approval.
- Splash-proof construction (NEMA4X: equivalent to IP66).

 Refer to *Safety Precautions for All Digital Panel Meters*.



## Model Number Structure

### ■ Model Number Legend

**K3GN-□□-□-□ 24 VDC**  
          1   2   3   4

#### 1. Input Type

- ND: DC voltage/current, NPN  
PD: DC voltage/current, PNP

#### 2. Output Type

- C: 2 relay contact outputs (SPST-NO)  
C-FLK: 2 relay contact outputs (SPST-NO) and RS-485  
C-L1: 2 relay contact outputs (SPST-NO) and DC current (0 to 20 mA, 4 to 20 mA)  
C-L2: 2 relay contact outputs (SPST-NO) and DC voltage (0 to 5 V, 1 to 5 V, 0 to 10 V)  
T1: 3 transistor outputs (NPN open collector)  
T1-FLK: 3 transistor outputs (NPN open collector) and RS-485  
T1-L1: 3 transistor outputs (NPN open collector) and DC current (0 to 20 mA, 4 to 20 mA)  
T1-L2: 3 transistor outputs (NPN open collector) and DC voltage (0 to 5 V, 1 to 5 V, 0 to 10 V)  
T2: 3 transistor outputs (PNP open collector)  
T2-FLK: 3 transistor outputs (PNP open collector) and RS-485

#### 3. Option

- None: None  
-400: Normally energized relays

#### 4. Supply Voltage

- 24 VDC: 24 VDC

# Ordering Information

## List of Models

| Supply voltage                            | Input type                                 | Output type  |  | Model                   |
|---|--|--|--|-------------------------|
|   |  | Judgement output   | Data transmission output                   |                         |
| 24 VDC                                    | DC voltage, DC current, or NPN input       | 2 relay contact outputs (SPST-NO)  | None                                       | K3GN-NDC 24 VDC         |
|   |  |  | RS-485                                     | K3GN-NDC-FLK 24 VDC     |
|   |  |  | DC current (0 to 20 mA, 4 to 20 mA)        | K3GN-NDC-L1 24 VDC      |
|   |  |  | DC voltage (0 to 5 V, 1 to 5 V, 0 to 10 V) | K3GN-NDC-L2 24 VDC      |
|   |  | 2 relay contact outputs (SPST-NO)<br>Normally energized relays (See note.) | None                                       | K3GN-NDC-400 24 VDC     |
|   |  |  | RS-485                                     | K3GN-NDC-FLK-400 24 VDC |
|   |  |  | DC current (0 to 20 mA, 4 to 20 mA)        | K3GN-NDC-L1-400 24 VDC  |
|   |  |  | DC voltage (0 to 5 V, 1 to 5 V, 0 to 10 V) | K3GN-NDC-L2-400 24 VDC  |
|   |  | 3 transistor outputs (NPN open collector)                                  | None                                       | K3GN-NDT1 24 VDC        |
|   |  |  | RS-485                                     | K3GN-NDT1-FLK 24 VDC    |
|   | DC current (0 to 20 mA, 4 to 20 mA)        |  | K3GN-NDT1-L1 24 VDC                        |                         |
|   | DC voltage (0 to 5 V, 1 to 5 V, 0 to 10 V) |  | K3GN-NDT1-L2 24 VDC                        |                         |
|   | DC voltage, DC current, or PNP input       | 2 relay contact outputs (SPST-NO)  | None                                       | K3GN-PDC 24 VDC         |
|   |  |  | RS-485                                     | K3GN-PDC-FLK 24 VDC     |
| 3 transistor outputs (PNP open collector) |  | None   | K3GN-PDT2 24 VDC                           |                         |
|   |  | RS-485   | K3GN-PDT2-FLK 24 VDC                       |                         |

Note: Refer to page 5 for information on models with normally energized relays.

## Specifications

### Ratings

| Item   |                          | K3GN-ND<br>With DC voltage, DC current, and NPN input   | K3GN-PD<br>With DC voltage, DC current, and PNP input |
|--|--------------------------|---|---|
| Supply voltage                                 |                          | 24 VDC  |   |
| Operating voltage range                        |                          | 85% to 110% of the rated supply voltage   |   |
| Power consumption (at max. load) (See note 1.) |                          | 2.5 W max. (at max. DC load with all indicators lit)  |   |
| Input signal                                   |                          | DC voltage, DC current, no-voltage contact, open collector  |   |
| DC voltage/current input                       | A/D conversion           | Double integral method  |   |
| Pulse signal input                             | Pulse measurement method | Periodic measurement method   |   |
| External power supply                          |                          | None  |   |
| Control input                                  |                          | Present value hold or forced zero (selectable) (See note 2.)  |   |
| Outputs (Outputs depend on the model.)         | Relay contact output     | 1 A, 30 VDC (resistive load), mechanical life: 50,000,000 operations min., electrical life: 100,000 operations min.   |   |
|  | Transistor output        | Max. load voltage: 24 VDC, Max. load current: 50 mA, Leakage current: 100 μA max.   |   |
|  | Communications output    | RS-485 (2-wire, half-duplex)  |   |
|  | Linear output            | DC current (0 to 20 mA DC, 4 to 20 mA): Load: 500 Ω max., Resolution: Approx. 10,000<br>DC voltage (0 to 5 VDC, 1 to 5 VDC, 0 to 10 VDC): Load: 5k Ω min., Resolution: Approx. 10,000 | ---   |
| Display  |                          | Negative LCD (backlit LCD) display<br>7-segment digital display, character height: 7.0 mm, and single illuminated display   |   |
| Main functions                                 |                          | Scaling, prescaling, teaching, average processing, forced zero, display color selection, output type selection, key protection, startup compensation timer, hysteresis                |   |
| Ambient temperature                            |                          | Operating: -10°C to 55°C (with no condensation or icing)<br>Storage: -25°C to 65°C (with no condensation or icing)  |   |
| Ambient humidity                               |                          | Operating: 25% to 85%   |   |
| Altitude                                       |                          | 2,000 m max.  |   |
| Accessories                                    |                          | Rubber packing, fixture, operation manual   |   |







Note: 1. A control power supply capacity greater than the rated capacity is required when the Digital Panel Meter is turned ON. Do not forget to take this into consideration when using several Digital Panel Meters. When power is supplied, all indicators will light and outputs will be OFF. When using startup compensation time operation, the display will read "00000" and all outputs will be OFF.

2. Enabled only when using DC voltage/current input. (Min.time for control signal input: 80 ms)

## Characteristics

| Item  | K3GN-ND<br>With DC voltage, DC current, and NPN input  |   | K3GN-PD<br>With DC voltage, DC current, and PNP input   |
|---|--|---|---|
|   | Input signal   | DC voltage/current (4 to 20 mA, 1 to 5 V, $\pm 5$ V, $\pm 10$ V)<br>No-voltage contact (30 Hz max. with ON/OFF pulse width of 16 ms min.)<br>Open collector (5 kHz max. with ON/OFF pulse width of 90 $\mu$ s min.) |   |
| Displayable range                                     | 5 digits (-19999 to 99999)   |   |   |
| Sampling period                                       | 250 ms   |   |   |
| Display refresh period                                | Sampling period: 250 ms (at 4 Hz min.), $250 \times$ Number of averaging times (ms) (with average processing selected),<br>Input pulse cycle (at less than 4 Hz): Input pulse cycle $\times$ Number of averaging times   |   |   |
| Comparative output response time (transistor outputs) | 750 ms max. (transistor output)<br>(The time required for the judgment output to be output if the input signal rapidly changes from 15% to 95% or from 95% to 15%.)  |   |   |
| Linear output response time                           | 750 ms max. (The time required for the analog output to be output if the output signal rapidly changes from 15% to 95% or from 95% to 15%.)  | ---   |   |
| Insulation resistance                                 | 20 M $\Omega$ min. (at 500 VDC) between external terminal and case.<br>Insulation provided between inputs, outputs, and power supply.  |   |   |
| Dielectric strength                                   | 1,000 VAC for 1 min between external terminal and case.  |   |   |
| Noise immunity  | $\pm 480$ V on power supply terminals in normal mode, $\pm 1,500$ V in common mode, $\pm 1$ $\mu$ s, or 100 ns for square-wave noise with 1 ns   |   |   |
| Vibration resistance                                  | Vibration frequency: 10 to 55 Hz, Acceleration: 50 m/s <sup>2</sup> for 10 min each in X, Y, and Z directions  |   |   |
| Shock resistance                                      | Models with transistor outputs: 150 m/s <sup>2</sup> three times each in 3 axes, 6 directions<br>Models with contact outputs: 100 m/s <sup>2</sup> three times each in 3 axes, 6 directions  |   |   |
| Weight  | Approx. 100 g (Main Unit only)   |   |   |
| Degree of protection                                  | Front panel  | NEMA4X for indoor use (equivalent to IP66),   |   |
|   | Rear case  | IP20  |   |
|   | Terminals  | IP00 and finger protection (VDE0106/100)  |   |
| Memory protection                                     | Non-volatile memory (EEPROM) (possible to rewrite 100,000 times)   |   |   |
| Approved standards                                    | UL508, CSA C22.2 No. 142   |   |   |
| EMC   | (EMI) Emission Enclosure: EN 61326<br>(EMS) Immunity ESD: EN 61326<br>Immunity RF-interference: EN 61000-4-2:<br>Immunity Fast Transient Noise: EN 61000-4-3:<br>Immunity Burst Noise: EN 61000-4-4:<br>Immunity Surge: EN 61000-4-5:<br>Immunity Conducted Disturbance: EN 61000-4-6:<br>Immunity Power Frequency Magnetic: EN 61000-4-8: | EN 61326<br>EN55011 Group 1 class A<br>EN 61326<br>EN 61000-4-2:<br>EN 61000-4-3:<br>EN 61000-4-4:<br>EN 61000-4-5:<br>EN 61000-4-6:<br>EN 61000-4-8:   | Industry<br>4 kV (contact discharge)<br>8 kV (air discharge)<br>10 V/m (amplitude-modulated, 80 MHz to 1 GHz)<br>2 kV (power line)<br>1 kV line to line (I/O signal line)<br>2 kV line to ground (power line)<br>3 V (0.15 to 80 MHz)<br>30 A/m (50 Hz) continuous time |

## Input Ranges: Measurement Range and Accuracy

| Input type<br>Input   | Analog<br>ANALOG  |                       |   |   |   | Pulse<br>PULSE           |   |   | Remote<br>REMOTE   |
|-----------------------|---|-----------------------|---|---|---|--------------------------|---|---|--|
|                       | DC current input  | DC voltage input      |   |   |   | Rotary pulse             |   |   |  |
| Analog range<br>RANGE | 4 to 20 mA<br>4-20  | Analog range<br>RANGE | 1 to 5 V<br>1-5   | $\pm 5$ V<br>5  | $\pm 10$ V<br>10  | Pulse frequency<br>P-FRE | 30 Hz<br>30   | 5 kHz<br>5K   | Range of display from <del>19999</del> to <del>99999</del> using communications. |
| Connection terminal   | ⑤-⑥   | Connection terminal   | ④-⑤   |   |   | Connection terminal      | ②-③   |   |  |
| Current range (mA)    |  | Voltage range (V)     |  |  |  | Frequency range (Hz)     |  |  |  |
| Input impedance       | 60 $\Omega$   | Input impedance       | 1 M $\Omega$ min.   |   |   | ---                      |   |   |  |
| Measurement accuracy  | $\pm 0.1\%$ full scale $\pm$ one digit max. (at 23 $\pm 3^\circ$ C)                 |                       | $\pm 0.1\%$ full scale $\pm$ one digit max. (at 23 $\pm 5^\circ$ C)                 |   | $\pm 0.1\%$ full scale $\pm$ one digit max. (at 23 $\pm 5^\circ$ C)                 |                          |   | ---   |  |

Note: The shaded ranges indicate default settings.

## ■ Input/Output Ratings

### Relay Contact Output

(Incorporating G6K Relays)

| Item  | Resistive load ( $\cos\phi = 1$ )   |
|---|---|
| Rated load  | 1 A at 30 VDC   |
| Rated through current                               | 1 A max. (at COM terminal)  |
| Max. contact voltage                                | 60 VDC  |
| Max. contact current                                | 1 A (at COM terminal)   |
| Max. switching capacity                             | 30 VA   |
| Min. permissible load (P level, reference value)    | 10 mV, 10 $\mu$ A   |
| Mechanical life                                     | 50,000,000 operations min. (at a switching frequency of 36,000 operations/hr)                 |
| Electrical life (at an ambient temperature of 23°C) | 100,000 operations min. (at the rated load with a switching frequency of 1,800 operations/hr) |

### Transistor Output

|                    |                  |
|--------------------|------------------|
| Rated load voltage | 24 VDC           |
| Max. load current  | 50 mA            |
| Leakage current    | 100 $\mu$ A max. |

### Communications Specifications

| Item                   | RS-485  |
|------------------------|---|
| Communications method  | 2-wire, half-duplex   |
| Synchronization method | Start-stop synchronization  |
| Baud rate              | 1,200/2,400/4,800/9,600/19,200 bps  |
| Transmission code      | ASCII   |
| Communications         | Reading/Writing to the K3GN   |
|                        | Read/write comparative set values, read/write scaling values, enable/disable the writing of data through communications, forced-zero control, and other data. |

### Linear Output

| Item                       | 0 to 20 mA             | 4 to 20 mA | 0 to 5 V   | 1 to 5 V | 0 to 10 V |
|----------------------------|------------------------|------------|--|----------|-----------|
| Permissible load impedance | 500 $\Omega$ max.      |            | 5 k $\Omega$ min.  |          |           |
| Resolution                 | Approx. 10,000         |            |  |          |           |
| Output error               | $\pm 0.5\%$ full scale |            | $\pm 0.5$ full scale.<br>$\pm 0.15$ V at 1 V or less (no output for 0 or less) |          |           |

# Nomenclature



| Name                        |             | Functions  |
|-----------------------------|-------------|--|
| <b>1. Main display</b>      |             | Displays process values, parameters, and set values.   |
| <b>2. Status indicators</b> | <b>OUT1</b> | Lit when output 1 is ON.   |
|                             | <b>OUT2</b> | Lit when output 2 is ON.   |
|                             | <b>SV</b>   | Lit when a set value is being displayed or changed.  |
|                             | <b>T</b>    | Lit when the teaching function is enabled. Flashes when the K3GN is in teaching operation. Lit when a calibration value is being displayed during user calibration. Flashes while reading a calibration value. |
|                             | <b>ZERO</b> | Lit while the forced-zero function is activated.   |
|                             | <b>HOLD</b> | Lit when HOLD input is ON.   |
|                             | <b>CMW</b>  | Lit when communications writing is "enabled" and is out when it is "disabled."   |
| <b>3. Level indicator</b>   |             | Displays the current level that the K3GN is in. (See below for details.)   |
| <b>4. Level Key</b>         |             | Used to change the level.  |
| <b>5. Mode Key</b>          |             | Used to allow the Main display to indicate parameters sequentially.  |
| <b>6. Shift Key</b>         |             | Used to enable that set value to be changed. When changing a set value, this key is used to move along the digits.   |
| <b>7. Up/Zero Key</b>       |             | Used to change a set value. Used to set or clear a forced-zero function when a measurement value is being displayed.   |

| Level indicator | Level                     |
|-----------------|---------------------------|
| <b>P</b>        | Protect                   |
| Not lit         | Operation                 |
| <b>R</b>        | Adjustment                |
| <b>S</b>        | Initial setting           |
| <b>C</b>        | Communications setting    |
| <b>F</b>        | Advanced function setting |
| <b>U</b>        | User calibration          |

## Models with Normally Energized Relays

### K3GN-NDC-□-400 24 VDC

- The drive operation for the output relay is reversed in these models.
- Relay contacts can be made open (i.e., OFF) when comparative set values are being judged. This is effective when constructing systems that take failsafe measures into consideration.

#### List of Models


| Models with Normally Energized Relays |
|---------------------------------------|
| K3GN-NDC-400 24 VDC                   |
| K3GN-NDC-FLK-400 24 VDC               |
| K3GN-NDC-L1-400 24 VDC                |
| K3GN-NDC-L2-400 24 VDC                |

## Relation between Output Type and Relay Output Operation




# Connections

## Terminal Arrangement

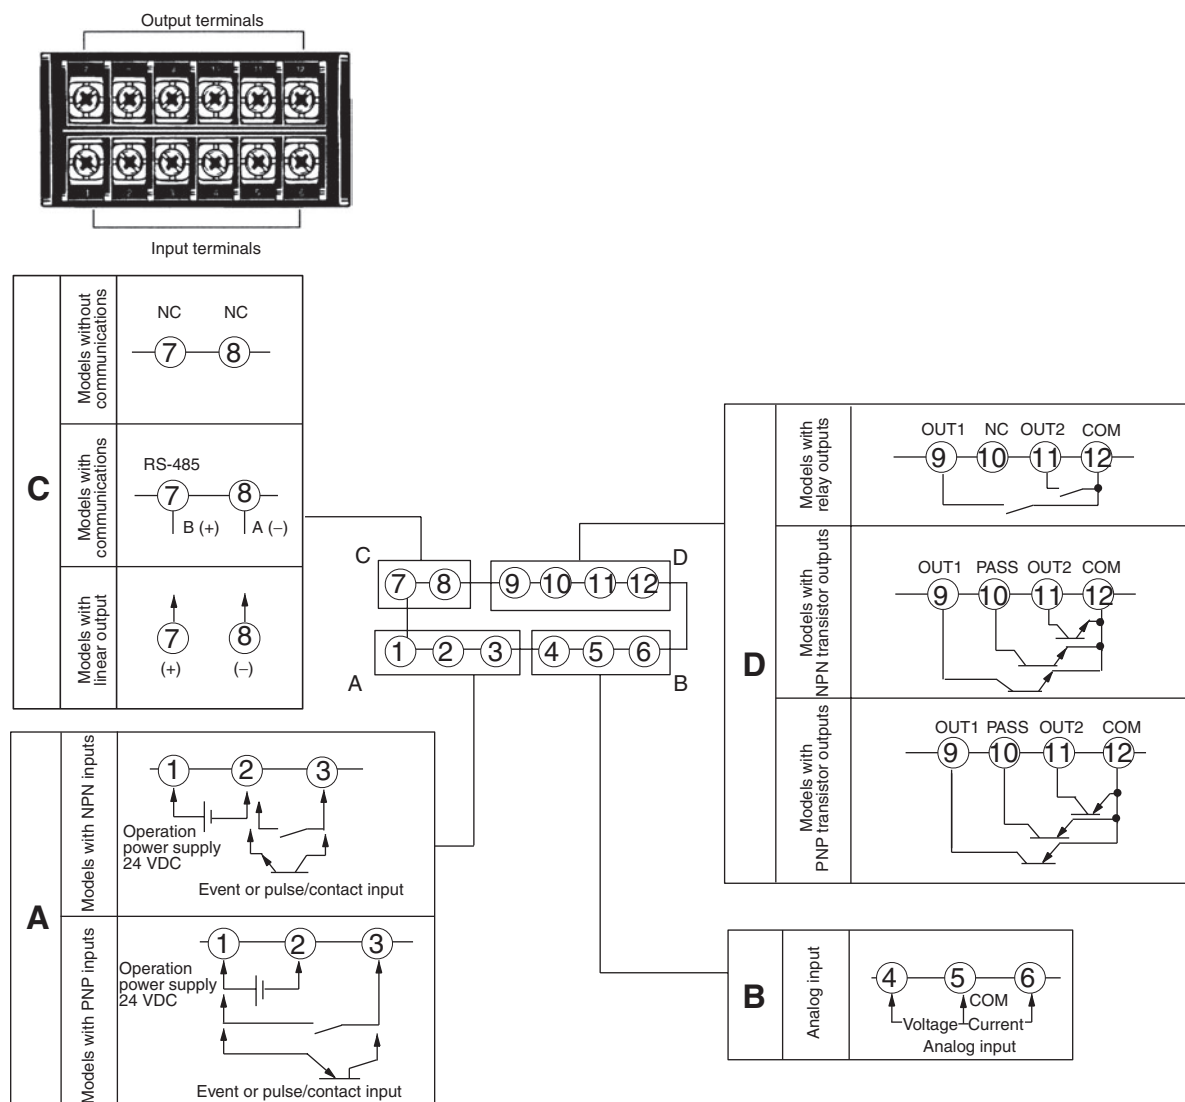

| Terminal No. | Name                               | Description   |
|--------------|------------------------------------|---|
| ①-②          | Operation power                    | Connect the operation power supply.   |
| ③-②          | Event input or pulse/contact input | Operates as follows depending on parameter setting:<br><ul style="list-style-type: none"> <li>• Holds process value.</li> <li>• Calibrate the process value to zero and clear the forced-zero function.</li> <li>• Pulse or contact input.</li> </ul> |
| ③-①          |                                    |   |
| ④,⑥-⑤        | Analog input                       | Connect the voltage or current analog input.  |
| ⑦-⑧          | Communications                     | RS-485 communications terminals.  |
|              | Linear output                      | 0 to 20 mA DC, 4 to 20 mA DC<br>0 to 5 VDC, 1 to 5 VDC, 0 to 10 VDC   |
| ⑨,⑪-⑫        | Outputs                            | Outputs relay or transistor outputs. There is also a PASS output for models with transistor outputs.  |
| ⑨,⑩,⑪-⑫      |                                    |   |

## Block Diagram

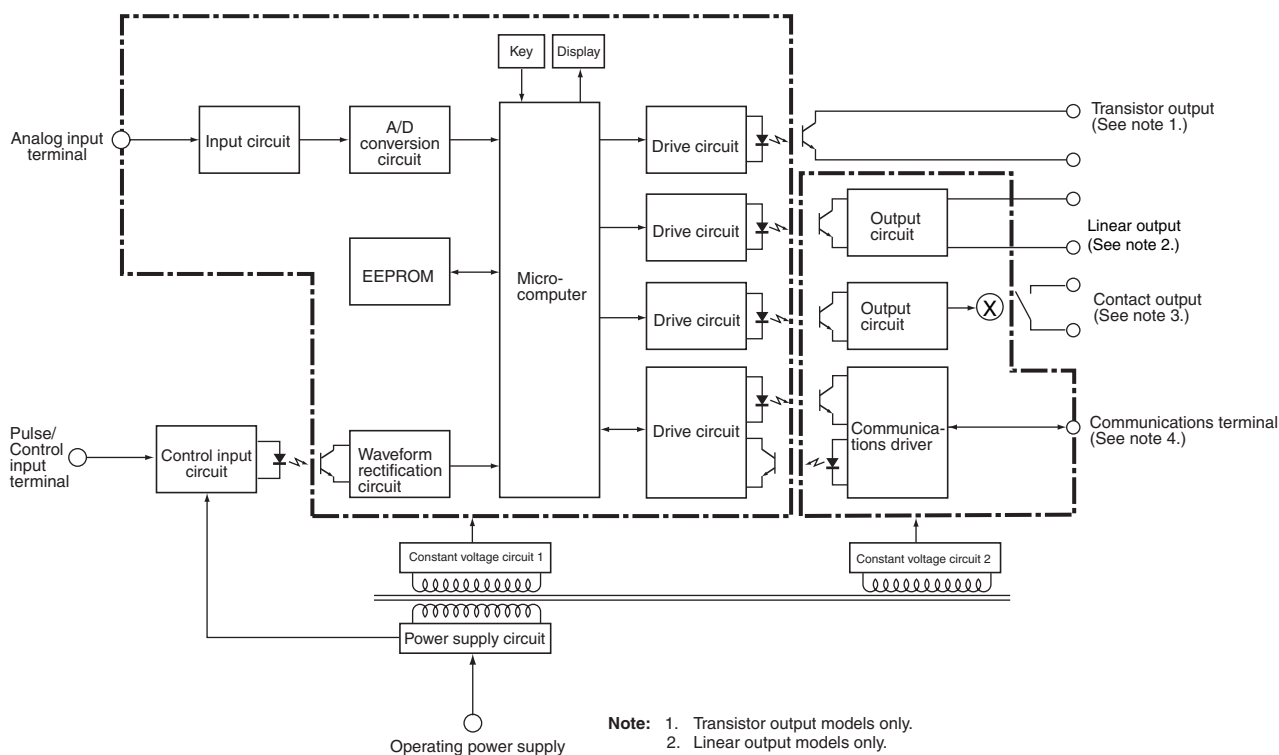


- Note:**
1. Transistor output models only.
  2. Linear output models only.
  3. Relay output models only.
  4. Models with communications functions only.

## Input Circuits


### Analog Input (DC Voltage/Current)

Use terminal 5 for analog common.

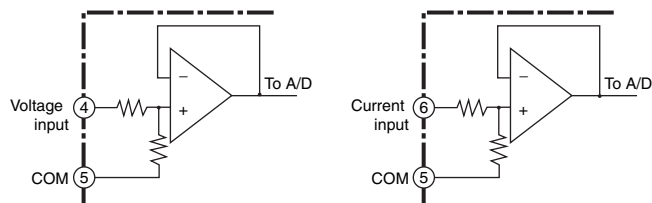


### Comparative Output

#### Contact Output

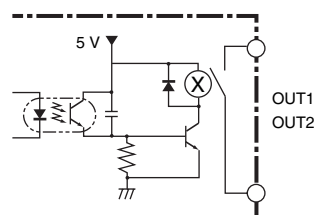


### Transistor Output

#### NPN Output

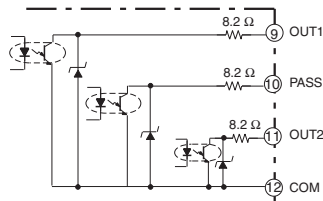


#### PNP Output

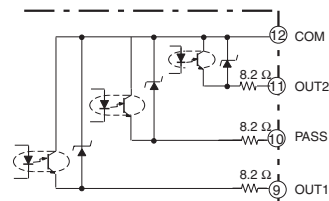


### Pulse Input/ Event Input (HOLD/ZERO)

- If analog input is selected, 2 and 3 will be the event inputs. Select Hold/Zero with event input allocation.
- Use terminal 2 for the common terminal.
- Use the NPN open collector or the no-voltage contacts for the control input.

### NPN Input

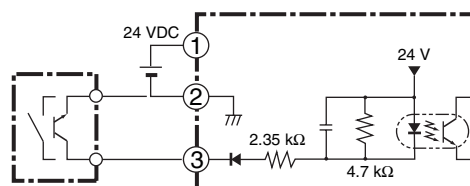

### PNP Input

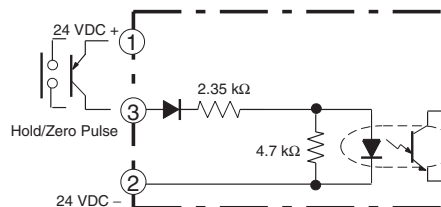

## Linear Output



**Note:** The commons for linear output and transistor output on models with L1 and L2 are connected internally.

Depending on how the common is wired for externally connected devices, unwanted current paths for the linear output signal in the circuit may prevent the output signal from being output.

When connecting an external device, externally connect a relay to the transistor output or provide another means of insulation.



# Operating Procedures

## Initial Setting Flowchart



### Input Type

| Input type | Parameter          | Function  |
|------------|--------------------|---|
| Analog     | $\overline{ANAL}$  | Selects the DC voltage/current signal input.                              |
| Pulse      | $\overline{PULSE}$ | Selects the pulse input signal.   |
| Remote     | $\overline{RMT}$   | Displays the communications remote data from the Programmable Controller. |

**Note:** The default value is  $\overline{ANAL}$ : Analog input.

### Analog Input Type

#### K3GN-ND□

| Input specification | Parameter         | Setting range   |
|---------------------|-------------------|---|
| 4 to 20 mA          | $\overline{4-20}$ | Values from –19999 to 99999 can be displayed with scaling. The position of the decimal point can be set as desired. |
| 1 to 5 V            | $\overline{1-5}$  |   |
| ±5 V                | $\overline{5}$    |   |
| ±10 V               | $\overline{10}$   |   |

**Note:** The default value is  $\overline{4-20}$ : 4 to 20 mA input range.

#### K3GN-NL□ (with Microvoltage Input)

| Input specification | Parameter          | Setting range   |
|---------------------|--------------------|---|
| ±199.9 mV           | $\overline{199.9}$ | Values from –19999 to 99999 can be displayed with scaling. The position of the decimal point can be set as desired. |
| ±19.99 mV           | $\overline{19.99}$ |   |

**Note:** The default value is  $\overline{199.9}$ : ±199.9 mV input range.

### Pulse Frequency

| Input specification | Parameter         | Setting range   |
|---------------------|-------------------|---|
| 0.05 Hz to 30.00 Hz | $\overline{30}$   | Values from –19999 to 99999 can be displayed with scaling. The position of the decimal point can be set as desired. |
| 0 Hz to 5 kHz       | $\overline{5\mu}$ |   |

**Note:** The default value is  $\overline{5\mu}$ : 5 kHz input range.

### Setting Scaling

#### Analog Input Signal

(Refer to page 10 if a pulse input is selected.)

- The scaling will be displayed on a line connecting two points by setting Display 1 for Input 1 and Display 2 for Input 2. The position of the decimal point can be set as desired. If the decimal point is to be displayed, it is necessary to consider the number of digits to be displayed past the decimal point when setting the scaling display value.  
**Note:** When pulse input is used, the base point is the 0 point, so the settings are only the input value and the display value.



Instead of setting by inputting with the Shift Key and Up Key, current measurement values can be input as scaling input values for teaching. This is useful for making settings while checking the operation status of the K3GN.  
 For details on the operating procedures, refer to the *K3GN Digital Panel Meter Manual* (Cat. No. N102).

- If the K3GN is used with a pulse signal input, the display value will be the input frequency if scaling is not performed.

Display the rate of rotation or the speed of a device or machine to which the K3GN is mounted by converting using scaling.

The relation between input  $f$  (Hz) and display  $D$  is expressed in the form  $D = f \times a$  (a factor). The value depends on the display unit. The formula will be comprised as follows:

Display using rpm:  $D = f \times 1/N \times 60$ ,  $N$  = Number of pulses per rotation,  $f$  = Input pulse frequency (Hz) (i.e., number of pulses in one second)

Display using m/min:  $D = f \times \pi d \times 1/N \times 60$ ,  $\pi d$  = Circumference length (m) per rotation



### Prescaling Example



To display the rotational speed of a device that outputs five pulses per rotation:

$$D = f \times 1/5 \times 60, \text{ and,}$$

If  $f=1$ ,

$$D = 12, \text{ so}$$


The setting will be completed by inputting  $\bar{L} \bar{a} P:1$  and  $dSP:12$ .

## Output 1 Type

| Output type            | Parameter                   | Function   |
|------------------------|-----------------------------|--|
| Upper limit            | $H\bar{L}$                  | Output turns ON if the measurement value $\geq$ comparative set value 1.   |
| Lower limit            | $\bar{L}\bar{a}$            | Output turns ON if the measurement value $\leq$ comparative set value 1.   |
| Upper and lower limits | $H\bar{L} - \bar{L}\bar{a}$ | The comparative upper-limit set value and comparative lower-limit set value can be set separately and expressed high and low. Output turns ON if the measurement value $\geq$ comparative upper-limit set value 1 or if the measurement value is $\leq$ comparative lower-limit set value 1. |

**Note:** The default value is  $H\bar{L}$ : Upper limit.

### Upper Limit

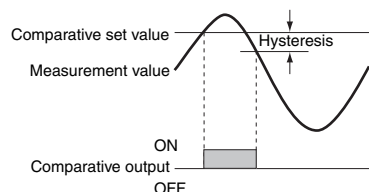

### Lower Limit



### Upper and Lower Limits




## Output 2 Type

| Output type           | Parameter                   | Function   |
|-----------------------|-----------------------------|--|
| Upper limit           | $H\bar{L}$                  | Output turns ON if the measurement value $\geq$ comparative set value 2.   |
| Lower limit           | $\bar{L}\bar{a}$            | Output turns ON if the measurement value $\leq$ comparative set value 2.   |
| Upper and lower limit | $H\bar{L} - \bar{L}\bar{a}$ | The comparative upper-limit set value and comparative lower-limit set value can be set separately and expressed high and low. Output turns ON if the measurement value $\geq$ comparative upper-limit set value 2 or if the measurement value is $\leq$ comparative lower-limit set value 2. |

**Note:** The default setting is  $\bar{L}\bar{a}$ : Lower limit.

The output operations can be selected separately for OUT1 and OUT2.


### Upper Limit 2-stage Output

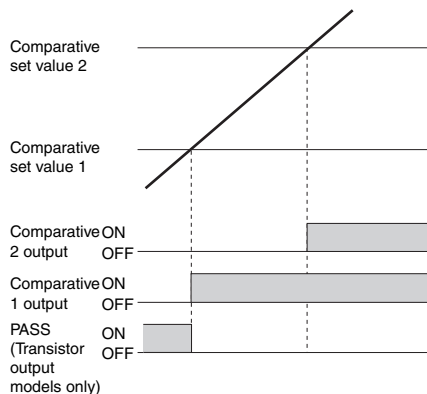

### Threshold Output




### Combination of Upper Limit and Upper/Lower Limits

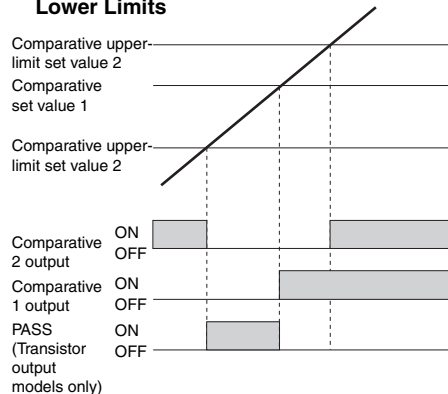

## Linear Output Type

| Linear output type  | Parameter | Meaning of set value            |
|---------------------|-----------|---------------------------------|
| Linear current type | 0-20      | Linear current type: 0 to 20 mA |
|                     | 4-20      | Linear current type: 4 to 20 mA |
| Linear voltage type | 0-5       | Linear voltage type: 0 to 5 V   |
|                     | 1-5       | Linear voltage type: 1 to 5 V   |
|                     | 0-10      | Linear voltage type: 0 to 10 V  |

# Setting Menu and Parameters

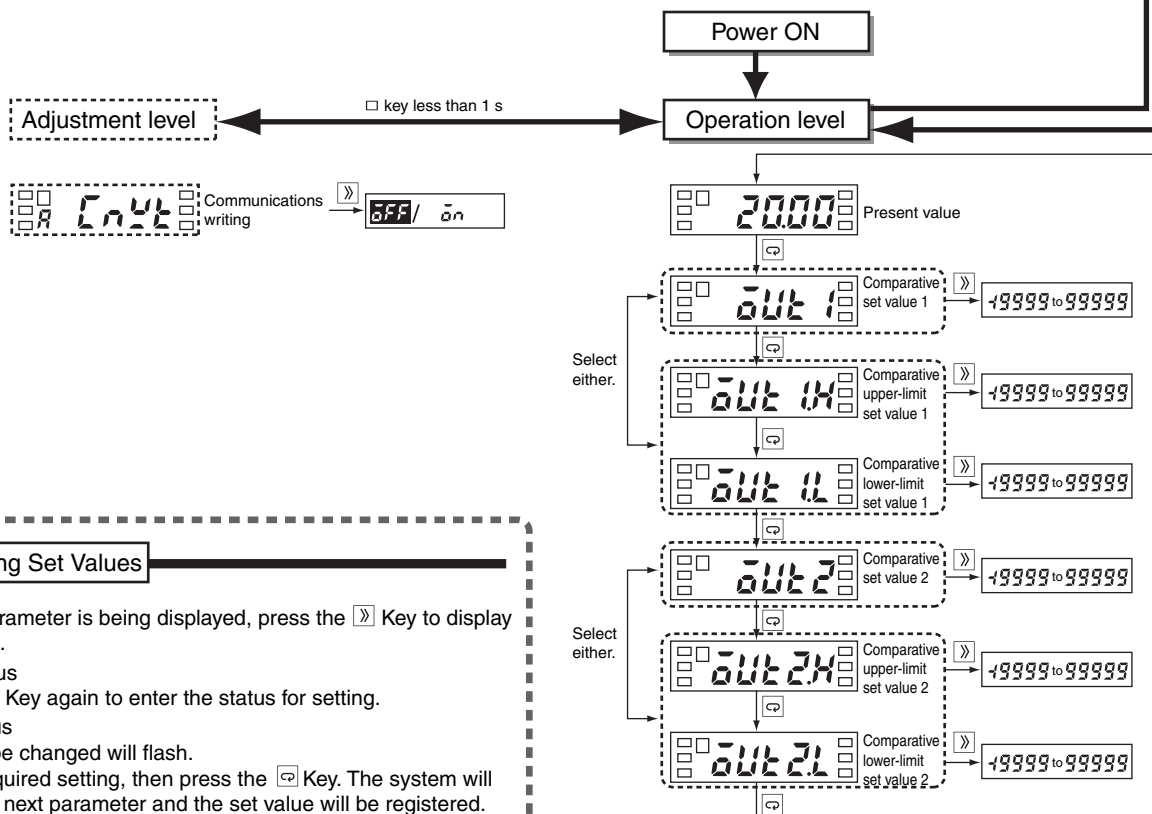

### Changing Set Values

While the parameter is being displayed, press the **▶** Key to display the set value.

**Monitor Status**  
Press the **▶** Key again to enter the status for setting.

**Setting Status**  
The part to be changed will flash.

Make the required setting, then press the **◀** Key. The system will switch to the next parameter and the set value will be registered.


To the next parameter

SV will flash.

If 5 s lapses without any key being pressed, the set value will be registered, and the system will return to monitor status.



The highlighted values indicate default settings.

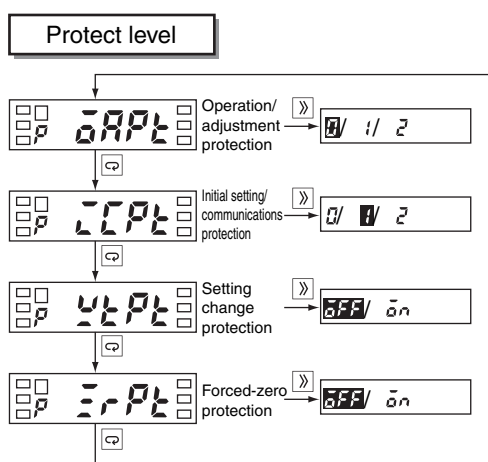

- Restricts menu display and writing in the operation level and adjustment level.
- Restricts menu display and moving for the initial setting level, communications setting level, and advanced setting level.
- Restricts changes to setup by operating the keys on the front panel.
- Restricts forced-zero operation by operating the keys on the front of the panel. (This item is not displayed if pulse input is used.)

## Operation/Adjustment Protection

Restricts key operation in the operation level and adjustment level.

| Setting | Operation level       |                           | Moving to adjustment level |
|---------|-----------------------|---------------------------|----------------------------|
|         | Present value display | Comparative value display |                            |
| 0       | Allowed               | Allowed                   | Allowed                    |
| 1       | Allowed               | Allowed                   | Prohibited                 |
| 2       | Allowed               | Prohibited                | Prohibited                 |

- The default setting is 0.
- Protection is not enabled when the setting is 0 (initial setting).

## Setting Change Protection

Restricts changes to settings.

| Setting | Details  |
|---------|--|
| OFF     | Changes to settings using the keys are allowed. (Moving to setting status is allowed.)       |
| ON      | Changes to settings using the keys are prohibited. (Moving to setting status is prohibited.) |

- The default setting is OFF.

**Note:** Changes to protection level parameters, moving to advanced function setting level, and moving to calibration level are all allowed.

## Initial Setting/Communications Protection

Restricts moving to the initial setting level, communications setting level, and advanced function setting level.

| Setting | Moving to initial setting level   | Moving to communications level |
|---------|---|--------------------------------|
| 0       | Allowed (message for moving to advanced function setting level displayed)     | Allowed                        |
| 1       | Allowed (message for moving to advanced function setting level not displayed) | Allowed                        |
| 2       | Prohibited  | Prohibited                     |

- The default setting is 1.

## Forced-zero Protection

Restricts the executing or clearing of a forced zero by using the keys.

| Setting | Details  |
|---------|--|
| OFF     | Executing or clearing of forced zero allowed.    |
| ON      | Executing or clearing of forced zero prohibited. |

- The default setting is OFF.

## ■ Error Displays (Troubleshooting)

If an error occurs, error information will be displayed on the main display. Check the error according to the display and correct the error as indicated.

| Main display           | Level display | Error details                        | Correction  |
|------------------------|---------------|--------------------------------------|---|
| E111 (E111)            | Not lit       | Memory error: RAM                    | Cycle the power supply. If the display does not change, replacement is required. If the error is removed, the original error may have been caused by noise. Check that there are no possible sources of noise nearby. |
| E111 (E111)            | 5             | Memory error: EEP                    |   |
| S.Err (S.Err) flashing | Not lit       | Input error or input range exceeded. | The outputs will all turn OFF. Check that the input wiring is correct, that there is no disconnection, or short-circuit, and that the input type is correct. Alternatively, limit the                                 |
| 99999 flashing         | Not lit       | Display range over: Upper limit      | This is not an error. It is displayed when the display range is exceeded even if the present value is within the input range and control range. Limit the input value and display value to within the range.          |
| -99999 Flashing        | Not lit       | Display range over: Lower limit      |   |

# Operation

## ■ Main Functions

### Scaling

The K3GN includes a scaling function that can convert the input signal to a desired value and display that value.

The displayed values can be freely adjusted to shift values, to create reversed displays, or to create positive/negative displays.



### Teaching

Teaching is used when using scaling or setting comparative set values to set the present measurement values as the set values instead of inputting with the Shift and Up/Zero Keys. Teaching is useful for making settings while checking the operation status of the K3GN.

### Average Processing

Average processing can be performed for measurement values using four levels (OFF, 2 times, 4 times, or 8 times). Average processing stabilizes displayed values by averaging the corresponding input signals that fluctuate dynamically. Select the appropriate number of averaging times depending on the application.

### Forced-zero Function

It is possible to shift from a value to the zero point with one touch of the Up/Zero Key on the front panel (for example, when adjusting reference values).

**Note:** This function can be used only when forced-zero operation protection is released.



### Changing the Display Color

The color of the value displayed can be set to either red or green. Make the setting according to the purpose and application of the equipment in which the K3GN is installed. The display color can also be set to change from green to red, or from red to green, according to the status of the comparison criteria.

### Output Type Selection

Output operation for comparative set values can be freely selected.

Upper limit: Output ON if the measurement value  $\geq$  comparative set value.

Lower limit: Output ON if the measurement value  $\leq$  comparative set value.

Upper/lower limit: Output ON if the measurement value  $\geq$  comparative upper-limit set value or if the measurement value is  $\leq$  the comparative lower-limit value.

### Key Protection

Key protection is used to restrict changes to displays and settings using the front panel keys and to restrict menu display and movement of operation levels. This function is effective for preventing misuse during operation.

### Startup Compensation Time (Rotary Pulse Input Only)

The startup compensation time parameter keeps the measurement operation from sending an unnecessary output corresponding to instantaneous, fluctuating input from the moment the K3GN is turned ON until the end of the preset period.




### Hysteresis

The hysteresis of comparative outputs can be set to prevent the chattering of relay or transistor outputs.

# Dimensions

Note: All units are in millimeters unless otherwise indicated.

## K3GN

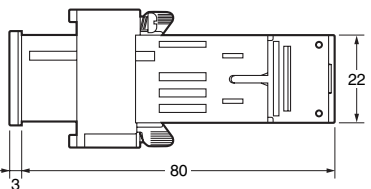


The K3GN uses M3 terminals. A terminal cover is provided.

### Main Display Character Size



### Panel Cutout Dimensions

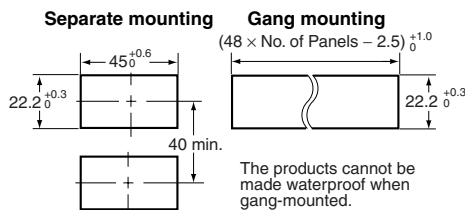


Mounting Recommended Panel Thickness 1 to 5 mm. Mount the product horizontally.

- For installation, insert the K3GN panel into the rectangular hole, insert the adaptor from the rear, and push it in to reduce the gap between the panel surface and the adaptor. Secure the Unit with the screws. For water-proof installation, insert the rubber gasket onto the body of the K3GN.
- If multiple mounted Units are used, make sure the ambient temperature for the K3GN does not exceed the specified temperature.

# Installation

1. Insert the K3GN into the panel cut-out hole.
2. For a waterproof installation, insert the rubber gasket onto the body of the K3MA-J.

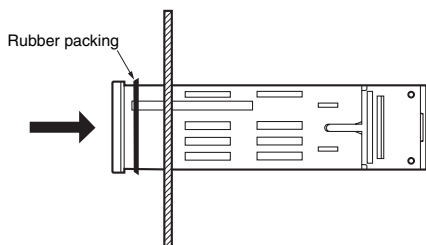

3. Fit the adaptor into the grooves on the left and right sides of the rear case, then push it until it contacts the panel to secure the K3MA-J.



### Angle of View

The K3GN is designed to provide the best visibility at the angles shown in the following diagram.



## Rubber Packing

The Rubber Packing ensures a waterproof level conforming to NEMA4X. Depending on the operating environment, deterioration, contraction, or hardening of the Rubber Packing may occur, making replacement necessary. Contact your OMRON representative if replacement is required.

## Wiring Precautions

- Wire the power supply with the correct polarity. Wiring with incorrect polarity may result in damage or burning.
- Wire the terminals using crimp terminals.
- Tighten terminal screws to a torque of approx. 0.5 N·m.
- Wire signal lines and power lines separately to reduce the influence of noise.


## Wiring

### Power Supply

- Input 24 VDC to terminals 1 and 2.



- Use M3 crimp terminals of the type shown below.





## Measurement Input

The following table shows the relation between input ranges and input terminals.

| Input range  |            | Input terminals |
|--|------------|-----------------|
| DC voltage/DC current  | 4 to 20 mA | ⑤-⑥             |
|  | 1 to 5 V   | ④-⑤             |
|  | ±5 V       |                 |
|  | ±10 V      |                 |
| No-voltage contacts and NPN open collector<br>(Models with NPN inputs) |            | ②-③             |
| No-voltage contacts and PNP open collector<br>(Models with PNP inputs) |            | ①-③             |

Be sure to read the Precautions for Correct Use and other information required when using the K3GN in the following user's manual.  
K3GN Digital Panel Meter User's Manual (Cat.No. N102)

ALL DIMENSIONS SHOWN ARE IN MILLIMETERS.

To convert millimeters into inches, multiply by 0.03937. To convert grams into ounces, multiply by 0.03527.

In the interest of product improvement, specifications are subject to change without notice.

## Read and Understand This Catalog

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

## Warranty and Limitations of Liability

### WARRANTY

OMRON's exclusive warranty is that the products are free from defects in materials and workmanship for a period of one year (or other period if specified) from date of sale by OMRON.

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, REGARDING NON-INFRINGEMENT, MERCHANTABILITY, OR FITNESS FOR PARTICULAR PURPOSE OF THE PRODUCTS. ANY BUYER OR USER ACKNOWLEDGES THAT THE BUYER OR USER ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. OMRON DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED.

### LIMITATIONS OF LIABILITY

OMRON SHALL NOT BE RESPONSIBLE FOR SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED ON CONTRACT, WARRANTY, NEGLIGENCE, OR STRICT LIABILITY.

In no event shall the responsibility of OMRON for any act exceed the individual price of the product on which liability is asserted.

IN NO EVENT SHALL OMRON BE RESPONSIBLE FOR WARRANTY, REPAIR, OR OTHER CLAIMS REGARDING THE PRODUCTS UNLESS OMRON'S ANALYSIS CONFIRMS THAT THE PRODUCTS WERE PROPERLY HANDLED, STORED, INSTALLED, AND MAINTAINED AND NOT SUBJECT TO CONTAMINATION, ABUSE, MISUSE, OR INAPPROPRIATE MODIFICATION OR REPAIR.

## Application Considerations

### SUITABILITY FOR USE

OMRON shall not be responsible for conformity with any standards, codes, or regulations that apply to the combination of products in the customer's application or use of the products.

At the customer's request, OMRON will provide applicable third party certification documents identifying ratings and limitations of use that apply to the products. This information by itself is not sufficient for a complete determination of the suitability of the products in combination with the end product, machine, system, or other application or use.

The following are some examples of applications for which particular attention must be given. This is not intended to be an exhaustive list of all possible uses of the products, nor is it intended to imply that the uses listed may be suitable for the products:

- Outdoor use, uses involving potential chemical contamination or electrical interference, or conditions or uses not described in this catalog.
- Nuclear energy control systems, combustion systems, railroad systems, aviation systems, medical equipment, amusement machines, vehicles, safety equipment, and installations subject to separate industry or government regulations.
- Systems, machines, and equipment that could present a risk to life or property.

Please know and observe all prohibitions of use applicable to the products.

NEVER USE THE PRODUCTS FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCTS ARE PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

### PROGRAMMABLE PRODUCTS

OMRON shall not be responsible for the user's programming of a programmable product, or any consequence thereof.

## Disclaimers

### CHANGE IN SPECIFICATIONS

Product specifications and accessories may be changed at any time based on improvements and other reasons.

It is our practice to change model numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the products may be changed without any notice. When in doubt, special model numbers may be assigned to fix or establish key specifications for your application on your request. Please consult with your OMRON representative at any time to confirm actual specifications of purchased products.

### DIMENSIONS AND WEIGHTS

Dimensions and weights are nominal and are not to be used for manufacturing purposes, even when tolerances are shown.

### PERFORMANCE DATA

Performance data given in this catalog is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of OMRON's test conditions, and the users must correlate it to actual application requirements. Actual performance is subject to the OMRON Warranty and Limitations of Liability.

### ERRORS AND OMISSIONS

The information in this document has been carefully checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical, or proofreading errors, or omissions.

2009.11

In the interest of product improvement, specifications are subject to change without notice.

**OMRON Corporation**  
Industrial Automation Company

<http://www.ia.omron.com/>

(c)Copyright OMRON Corporation 2009 All Right Reserved.

Компания «Океан Электроники» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Поставка оригинальных импортных электронных компонентов напрямую с производств Америки, Европы и Азии, а так же с крупнейших складов мира;
- Широкая линейка поставок активных и пассивных импортных электронных компонентов (более 30 млн. наименований);
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Помощь Конструкторского Отдела и консультации квалифицированных инженеров;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Поставка электронных компонентов под контролем ВП;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- При необходимости вся продукция военного и аэрокосмического назначения проходит испытания и сертификацию в лаборатории (по согласованию с заказчиком);
- Поставка специализированных компонентов военного и аэрокосмического уровня качества (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Actel, Aeroflex, Peregrine, VPT, Syfer, Eurofarad, Texas Instruments, MS Kennedy, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Компания «Океан Электроники» является официальным дистрибьютором и эксклюзивным представителем в России одного из крупнейших производителей разъемов военного и аэрокосмического назначения «JONHON», а так же официальным дистрибьютором и эксклюзивным представителем в России производителя высокотехнологичных и надежных решений для передачи СВЧ сигналов «FORSTAR».



## JONHON

«JONHON» (основан в 1970 г.)

Разъемы специального, военного и аэрокосмического назначения:

(Применяются в военной, авиационной, аэрокосмической, морской, железнодорожной, горно- и нефтедобывающей отраслях промышленности)

«FORSTAR» (основан в 1998 г.)

ВЧ соединители, коаксиальные кабели,  
кабельные сборки и микроволновые компоненты:

(Применяются в телекоммуникациях гражданского и специального назначения, в средствах связи, РЛС, а так же военной, авиационной и аэрокосмической отраслях промышленности).



Телефон: 8 (812) 309-75-97 (многоканальный)

Факс: 8 (812) 320-03-32

Электронная почта: [ocean@oceanchips.ru](mailto:ocean@oceanchips.ru)

Web: <http://oceanchips.ru/>

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, д. 2, корп. 4, лит. А