


IB IL 24 SEG-ELF ...

Inline Segment Terminal With Electronic Fuse

AUTOMATIONWORX

Data Sheet

© PHOENIX CONTACT - 01/2006

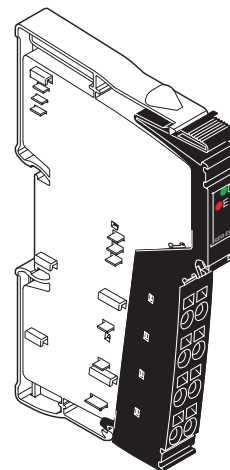

Description

The terminal is designed for use within an Inline station. The segment terminal is used to create a partial circuit (segment circuit) within the main circuit. It is not used to supply power and therefore has no elements for protection against polarity reversal and surge voltage. This terminal has an LED for bus diagnostics and occupies two input data bits, which are used to indicate the status of the electronic fuse.

Features

- Automatic creation of a segment circuit in the main circuit
- Protection of the segment circuit using an electronic fuse with short-circuit current limitation
- Diagnostic indicators
- Mapping the status of the electronic fuse in the input data
- Resetting the fuse via the bus system or manually using an optional external button



This data sheet is only valid in association with the IB IL SYS PRO UM E user manual or the Inline system manual for your bus system.



The product versions differ in the scope of supply and the transmission speed (see "Ordering Data" on page 2). The function is identical. Differing technical data is indicated.

For greater clarity, the order designation IB IL 24 SEG-ELF is used throughout this document.



Make sure you always use the latest documentation. It can be downloaded at www.download.phoenixcontact.com.

A conversion table is available on the Internet at www.download.phoenixcontact.com/general/7000_en_00.pdf.



This data sheet is valid for all products listed under "Ordering Data" on page 2.

Ordering Data

Terminals

Description	Type	Order No.	Pcs./Pkt.
Segment terminal with electronic fuse with connector and labeling field Transmission speed 500 kbaud	IB IL 24 SEG-ELF-PAC	2861409	1
Segment terminal with electronic fuse Transmission speed 500 kbaud	IB IL 24 SEG-ELF	2727789	1
Segment terminal with electronic fuse with connector and labeling field Transmission speed 2 Mbaud	IB IL 24 SEG-ELF-2MBD-PAC	2863847	1
Segment terminal with electronic fuse Transmission speed 2 Mbaud	IB IL 24 SEG-ELF-2MBD	2861182	1



One of the connectors listed below is needed for the complete fitting of the IB IL 24 SEG-ELF and IB IL 24 SEG-ELF-2MBD terminals.

Accessories

Description	Type	Order No.	Pcs./Pkt.
Connector (black, w/o color print)	IB IL SCN-PWR IN	2727462	10
Connector (black, with color print)	IB IL SCN-PWR IN-CP	2727637	10

Documentation

Description	Type	Order No.	Pcs./Pkt.
"Configuring and Installing the INTERBUS Inline Product Range" user manual	IB IL SYS PRO UM E	2743048	1
"Automation Terminals of the Inline Product Range" user manual	IL SYS INST UM E	2698737	1

Technical Data

General Data

Housing dimensions (width x height x depth)	12.2 mm x 120 mm x 71.5 mm
Weight (without connectors)	44 g, approximately (without connectors)
Weight (with connectors)	59 g, approximately (with connectors)
Operating mode	Process data mode with 2 bits
Permissible temperature (operation)	-25°C to +55°C
Permissible temperature (storage/transport)	-25°C to +85°C
Permissible humidity (operation)	75% on average, 85% occasionally



In the range from -25°C to +55°C appropriate measures against increased humidity (> 85%) must be taken.

Permissible humidity (storage/transport)	75% on average, 85% occasionally
------------------------------------------	----------------------------------



For a short period, slight condensation may appear on the outside of the housing if, for example, the terminal is brought into a closed room from a vehicle.

Permissible air pressure (operation)	80 kPa to 106 kPa (up to 2000 m above sea level)
Permissible air pressure (storage/transport)	70 kPa to 106 kPa (up to 3000 m above sea level)
Degree of protection	IP20 according to IEC 60529
Protection class	Class 3 according to VDE 0106, IEC 60536

Transmission Speed

IB IL 24 SEG-ELF	500 kbaud
IB IL 24 SEG-ELF-PAC	500 kbaud
IB IL 24 SEG-ELF-2MBD	2 Mbaud
IB IL 24 SEG-ELF-2MBD-PAC	2 Mbaud

Interface

Local bus	Through data routing
-----------	----------------------

Power Consumption (500 kbaud)

Communications power	7.5 V
Current consumption from the local bus	30 mA, maximum
Power consumption from the local bus	0.23 W, maximum
Main voltage U_M	24 V DC (nominal value)
Nominal current consumption at U_M	2.5 A (nominal value)

Power Consumption (2 Mbaud)

Communications power	7.5 V
Current consumption from the local bus	60 mA, maximum
Power consumption from the local bus	0.45 W, maximum
Main voltage U_M	24 V DC (nominal value)
Nominal current consumption at U_M	2.5 A (nominal value)

Supply of the Module Electronics and the I/O Through the Bus Terminal/Power Terminal (U_L , U_M)

Connection method	Through potential routing
-------------------	---------------------------

24 V I/O Supply (U_M , U_S)

The main voltage U_M is supplied by the bus terminal or by a power terminal. The segment voltage U_S is provided automatically at the IB IL 24 SEG-ELF terminal and protected by the internal electronic fuse.

Connections for a supply voltage are not provided on the segment terminal. The terminal points are **only** provided for measurement purposes and for connecting a button for resetting the blown fuse.

Digital Control Input

Number	1
Nominal voltage U_{IN}	24 V DC
Nominal current at U_{IN}	5 mA
Definition of switching thresholds	
Low level	< 5 V
High level	> 15 V
Permissible cable length to the external button	30 m (to ensure conformance with EMC directive 89/336/EEC)

Segment Circuit Protection

Nominal voltage	24 V DC
Permissible range	19.2 V DC to 30 V DC
Nominal current	2.5 A
Voltage drop at nominal current	0.5 V
Short-circuit current limiting	
Minimum	2.8 A
Maximum	8 A
Behavior after error	Latch function, i.e., remains switched off
Closing resistor	60 m Ω
Tripping time in the event of a short circuit	100 ms




The fuse is tripped by a thermal overload protection. The tripping time depends on the ambient temperature and the level of the short-circuit current. The data entered here applies for an ambient temperature of 25°C. The power supply unit must be able to provide a short-circuit current of at least 8 A.

Behavior When Ground Connection Interrupted

Leakage current when switched on (ON: communications power present)	2 mA, maximum
Output current when switched off (OFF: communications power not present)	200 μ A
Output voltage when switched off	1 V

Time/Current Characteristic (A) and Time/Resistance Characteristic (B) on Ohmic Overload (Ambient Operating Temperature $T_A = 25^\circ\text{C}$)

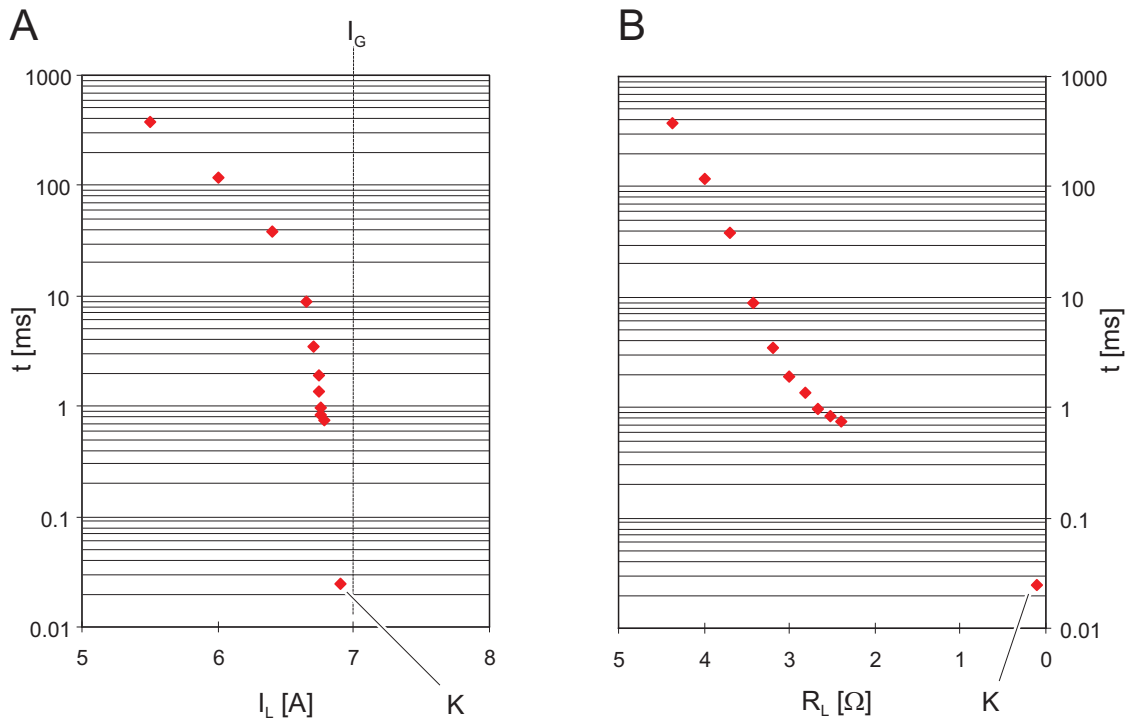

Where
 t Typical tripping time in ms
 I_L Load current in the segment circuit in A
 R_L Load impedance in the segment circuit in Ω
 I_G Current limit (typical)
 Value K Measured value on a hard short circuit

Power Dissipation



To keep the power dissipation to a minimum, the control input **must** be in the idle state (0 V). A constant supply to the control input of 24 V is **not** permitted. This technical connection measure is the basis for the calculations below.

Formula to Calculate the Power Dissipation of the Electronics (500 kbaud)

$$P_{TOT} = 0.23 \text{ W} + I_L^2 \times 0.06 \Omega$$

Where
 P_{TOT} Total power dissipation of the module
 I_L Load current in the segment circuit

Formula to Calculate the Power Dissipation of the Electronics (2 Mbaud)

$$P_{TOT} = 0.43 \text{ W} + I_L^2 \times 0.05 \Omega$$

Where
 P_{TOT} Total power dissipation of the module
 I_L Load current in the segment circuit

Power dissipation of the housing P_{HOH}

0.6 W (within the permissible operating temperature)

Derating on 30 V I/O Supply (U_M/U_S)

Maximum permissible load current in the segment circuit:

I_{Lmax}	= 2.5 A	at $-25^{\circ}\text{C} \leq T_A \leq +50^{\circ}\text{C}$
I_{Lmax}	= 2.0 A	at $+50^{\circ}\text{C} < T_A \leq +55^{\circ}\text{C}$

Safety Equipment

Overload/short circuit in the segment circuit	Yes (see page 4)
Surge voltage	Protective elements in the power terminal or the bus terminal
Polarity reversal	Protective elements in the power terminal or the bus terminal

Electrical Isolation/Isolation of the Voltage Areas



To provide electrical isolation between the logic level and the I/O area, it is necessary to supply these areas via the bus terminal or via the bus terminal and a power terminal from separate power supply units. Interconnection of the power supply units in the 24 V area is not permitted. (See also user manual.)

Common Potentials

The 24 V main voltage, 24 V segment voltage, and GND have the same potential. FE is a separate potential area.

Separate Potentials in the System Consisting of Bus Terminal/Power Terminal and I/O Terminal

- Test Distance

5 V supply incoming remote bus/7.5 V supply (bus logic)
5 V supply outgoing remote bus/7.5 V supply (bus logic)
7.5 V supply (bus logic)/24 V supply (I/O)
24 V supply (I/O)/functional earth ground

- Test Voltage

500 V AC, 50 Hz, 1 min.
500 V AC, 50 Hz, 1 min.
500 V AC, 50 Hz, 1 min.
500 V AC, 50 Hz, 1 min.

Error Messages to the Higher-Level Control or Computer System

Short circuit/overload in the segment circuit	Yes
-----------------------------------------------	-----



If a short circuit occurs in the segment circuit, an error message is generated. LEDs D and E on the terminal also flash to indicate the fault (see "Local Diagnostic Indicators" on page 7).

Falling below or exceeding the operating voltage	No
--------------------------------------------------	----

Approvals

CE	Yes
UL/CUL	Yes

Local Diagnostic Indicators and Terminal Point Assignment

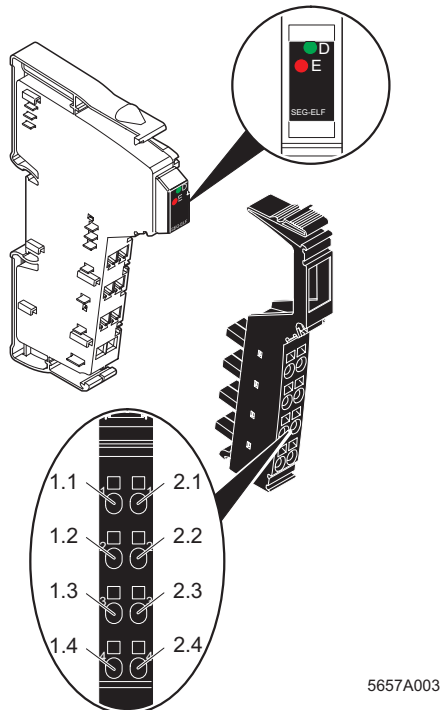


Figure 1 IB IL 24 SEG-ELF with the appropriate connector

5657A003

Local Diagnostic Indicators

Des.	Color	Meaning
D	Green	Diagnostics
	ON:	Bus active
	Flashing:	
	0.5 Hz:	Communications power present, bus not active
	2 Hz:	Communications power present, peripheral fault
	4 Hz:	Communications power present, local bus error
OFF:	Communications power not present, bus not active	
E	Red	Fuse in segment circuit (U_S)
	OFF:	Fuse OK
	ON:	Fuse has blown



A blown fuse is indicated by both diagnostic indicators. The red E LED is on and the green D LED flashes at 2 Hz.

Function Identification

Black

2 Mbaud: white stripe in the vicinity of the D LED

Terminal Point Assignment



The terminal points are **only** provided for measurement purposes and for connecting a manual reset button for the electronic fuse.

Terminal Point	Assignment
1.1	Connection of a manual reset button for the fuse (control input)
2.1	Connection of a manual reset button for the fuse (24 V)
1.2, 2.2	Measuring points for the main voltage U_M
1.3, 2.3	Measuring points for GND of supply voltages
1.4, 2.4	Measuring points for functional earth ground (FE)

Behavior of the Electronic Fuse

Function of the Fuse

The fuse monitors the maximum nominal current in the segment circuit, which must not exceed 2.5 A. The terminal indicates the status of the fuse via the E LED and via the two input data bits.

If the fuse blows, it remains in this state. The blown fuse is indicated by:

E LED	ON
D LED	Flashing at 2 Hz (peripheral fault)
Input bit	IN0 = 0 and IN1 = 0
Error message	Message to the higher-level control or computer system: Peripheral fault (PF)

Resetting the Fuse

There are three ways of resetting the fuse in an operational state:

- 1 Failure/deactivation and reactivation of the communications power at the bus terminal
- 2 24 V pulse at the control input
- 3 Control signal from the application program via the bus system


Resetting the Fuse Via the Control Input

To reset the fuse via the control input, connect an optional external button as shown in Figure 2.



The control input should only be supplied with 24 V to reset the fuse.

Set the control input to the idle state with 0 V or leave it open.

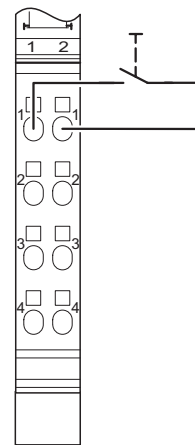

5657A004

Figure 2 Connection of a button for resetting the fuse

Resetting the Fuse Via a Control Signal From the Application Program

In order to reset the fuse from the application program, send the "Control_Device_Function" service in the firmware.

This service can be used to send control commands to one or more INTERBUS devices. For example, the service may be used to acknowledge a peripheral fault triggered by the electronic fuse and to reset it.



For more detailed information on firmware services, please refer to the "Firmware Services and Error Messages" user manual IBS SYS FW G4 UM E (Order No. 2745185).

Internal Circuit Diagram









Figure 3 Internal wiring of the terminal points

Key:

-  Protocol chip (bus logic including voltage conditioning)
-  LED with details of the display designation "D" or "E" (see page 7)
-  Optocoupler
-  Electronic fuse
-  Electrically isolated area

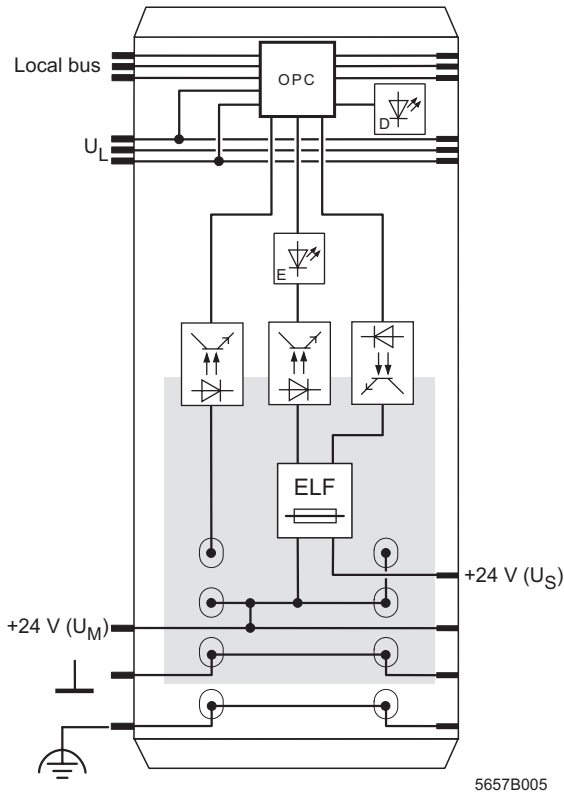

Other symbols used are explained in the IB IL SYS PRO UM E user manual or in the Inline system manual for your bus system.

Programming Data/Configuration Data

INTERBUS

ID code	BE _{hex} (190 _{dec})
Length code	C2 _{hex}
Input address area	2 bits
Output address area	0 bits
Parameter channel (PCP)	0 bits
Register length (bus)	2 bits

Other Bus Systems



For the programming data/configuration data of other bus systems, please refer to the corresponding electronic device data sheet (GSD, EDS).

Process Data

Assignment of IN Process Data



For the assignment of the illustrated (byte.bit) view to your **INTERBUS** control or computer system, please refer to the DB GB IBS SYS ADDRESS data sheet, Order No. 9000990.



The IN process data only maps the status of the electronic fuse.

Bit view	Bit	1	0
Assignment	Fuse OK	1	1
	Fuse has blown	0	0

© PHOENIX CONTACT 01/2006

Компания «Океан Электроники» предлагает заключение долгосрочных отношений при поставках импортных электронных компонентов на взаимовыгодных условиях!

Наши преимущества:

- Поставка оригинальных импортных электронных компонентов напрямую с производств Америки, Европы и Азии, а так же с крупнейших складов мира;
- Широкая линейка поставок активных и пассивных импортных электронных компонентов (более 30 млн. наименований);
- Поставка сложных, дефицитных, либо снятых с производства позиций;
- Оперативные сроки поставки под заказ (от 5 рабочих дней);
- Экспресс доставка в любую точку России;
- Помощь Конструкторского Отдела и консультации квалифицированных инженеров;
- Техническая поддержка проекта, помощь в подборе аналогов, поставка прототипов;
- Поставка электронных компонентов под контролем ВП;
- Система менеджмента качества сертифицирована по Международному стандарту ISO 9001;
- При необходимости вся продукция военного и аэрокосмического назначения проходит испытания и сертификацию в лаборатории (по согласованию с заказчиком);
- Поставка специализированных компонентов военного и аэрокосмического уровня качества (Xilinx, Altera, Analog Devices, Intersil, Interpoint, Microsemi, Actel, Aeroflex, Peregrine, VPT, Syfer, Eurofarad, Texas Instruments, MS Kennedy, Miteq, Cobham, E2V, MA-COM, Hittite, Mini-Circuits, General Dynamics и др.);

Компания «Океан Электроники» является официальным дистрибьютором и эксклюзивным представителем в России одного из крупнейших производителей разъемов военного и аэрокосмического назначения «JONHON», а так же официальным дистрибьютором и эксклюзивным представителем в России производителя высокотехнологичных и надежных решений для передачи СВЧ сигналов «FORSTAR».



JONHON

«JONHON» (основан в 1970 г.)

Разъемы специального, военного и аэрокосмического назначения:

(Применяются в военной, авиационной, аэрокосмической, морской, железнодорожной, горно- и нефтедобывающей отраслях промышленности)

«FORSTAR» (основан в 1998 г.)

ВЧ соединители, коаксиальные кабели, кабельные сборки и микроволновые компоненты:

(Применяются в телекоммуникациях гражданского и специального назначения, в средствах связи, РЛС, а так же военной, авиационной и аэрокосмической отраслях промышленности).



Телефон: 8 (812) 309-75-97 (многоканальный)

Факс: 8 (812) 320-03-32

Электронная почта: ocean@oceanchips.ru

Web: <http://oceanchips.ru/>

Адрес: 198099, г. Санкт-Петербург, ул. Калинина, д. 2, корп. 4, лит. А